



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

2nd Quarter, 2022



- **Total Energy Transmitted(GWh):**
5,551.49
- **Max System Demand (MW):**
3,246.00
- **Average Demand (MW):**
2,514.26
- **Load Factor (%)**
77.46

Number of Lines Outages

- Planned (#):
112
- Unplanned (#):
317

Automatic Load Shedding

- Number of Incidences (#):
103
- Total Duration (hh:mm):
31:36


Manual Load Shedding

- Number of Incidences (#):
103
- Total Duration (hh:mm):
302:36

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

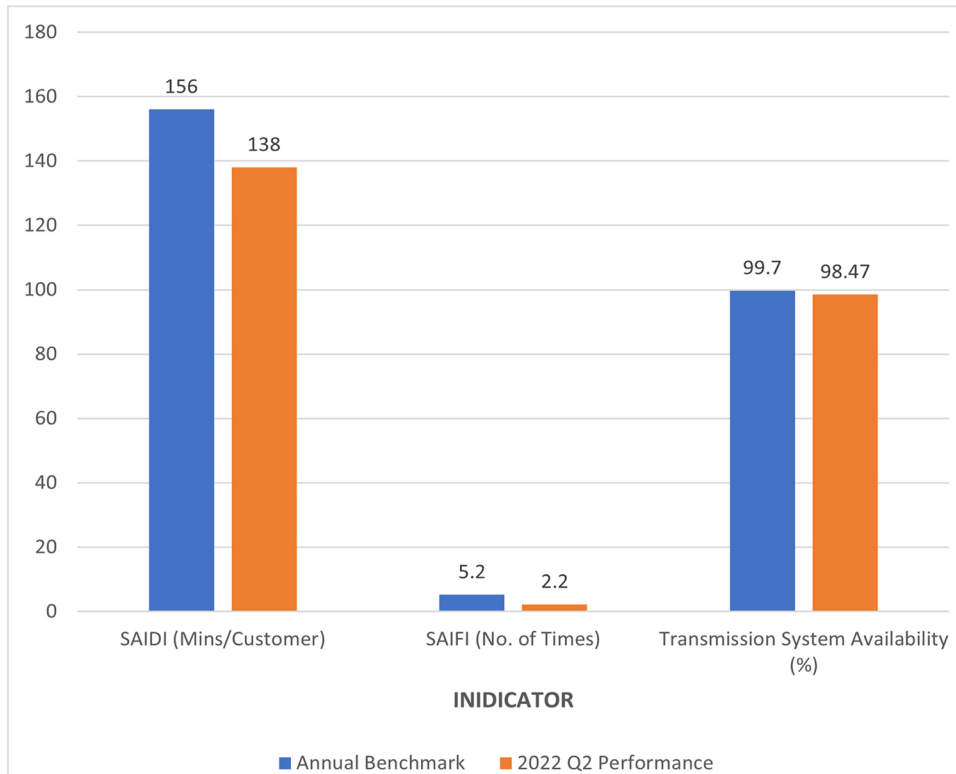

FREQUENCY DEVIATION

