



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

1st Quarter 2025



- **Total Energy Transmitted(GWh):**
6629.75
- **Max System Demand (MW):**
3556
- **Average Demand (MW):**
3002.6
- **Load Factor (%)**
82.99%

Number of Lines Outages

- Planned (#):
22
- Unplanned (#):
144

Automatic Load Shedding (AFLS)

- Number of incidence (#):
5
- Total Duration (hh:mm:ss):
09:12:00


Manual Load Shedding

- Number of Incidences (#):
71
- Total Duration (hh:mm:ss):
116:13:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

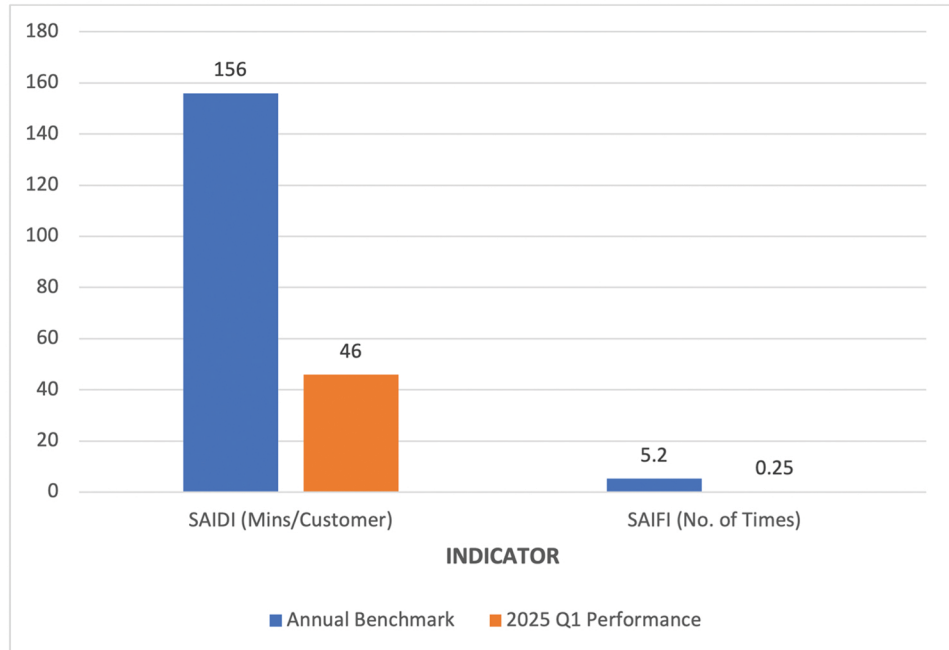

FREQUENCY DEVIATION

