



# PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

## Public Utilities Regulatory Information Systems (PURIS)

1st Quarter, 2022



- **Total Energy Transmitted(GWh):**  
5,846.66
- **Max System Demand (MW):**  
3,469.00
- **Average Demand (MW):**  
2,647.94
- **Load Factor (%)**  
76.33

### Number of Lines Outages

- Planned (#):  
128
- Unplanned (#):  
170

### Automatic Load Shedding

- Number of Incidences (#):  
3
- Total Duration (hh:mm):  
3:12


### Manual Load Shedding

- Number of Incidences (#):  
43
- Total Duration (hh:mm):  
47:00

**SAIDI:** System Average Interruption Duration Index

**SAIFI:** System Average Interruption Frequency Index

### Performance Statistics

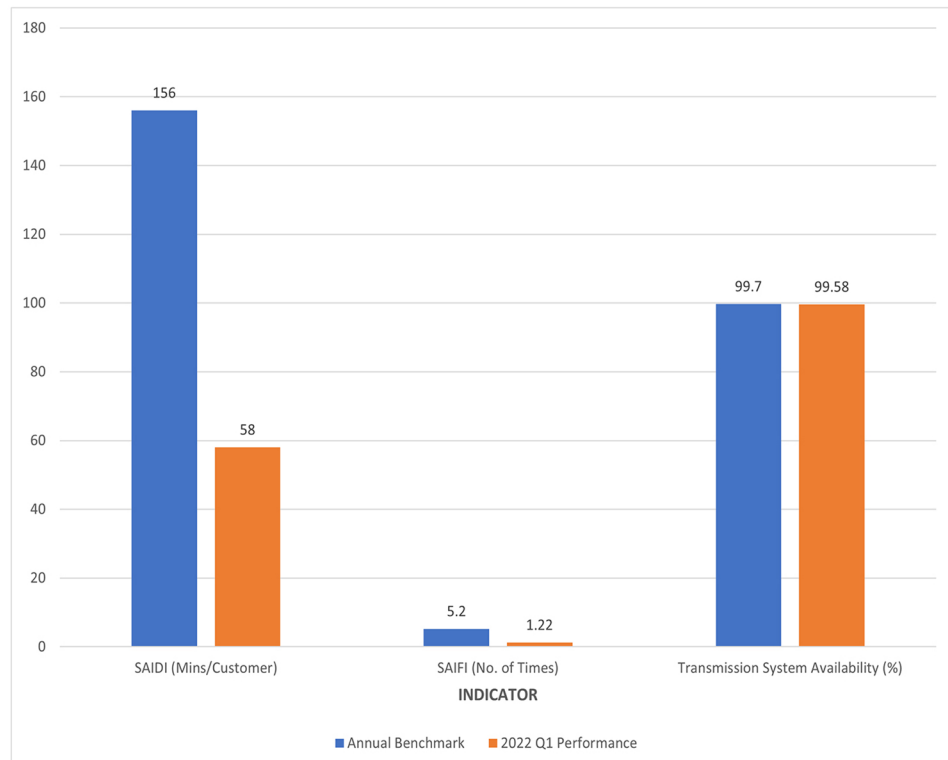

### FREQUENCY DEVIATION

