



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

4th Quarter, 2020



- **Total Energy Transmitted(GWh):**
5,210.07
- **Max System Demand (MW):**
3,448.00
- **Average Demand (MW):**
2,359.63
- **Load Factor (%)**
68.43%

Number of Lines Outages

- Planned (#):
98
- Unplanned (#):
364

Automatic Load Shedding

- Number of Incidences (#):
4
- Total Duration (hh:mm):
2:08


Manual Load Shedding

- Number of Incidences (#):
18
- Total Duration (hh:mm):
15:19

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

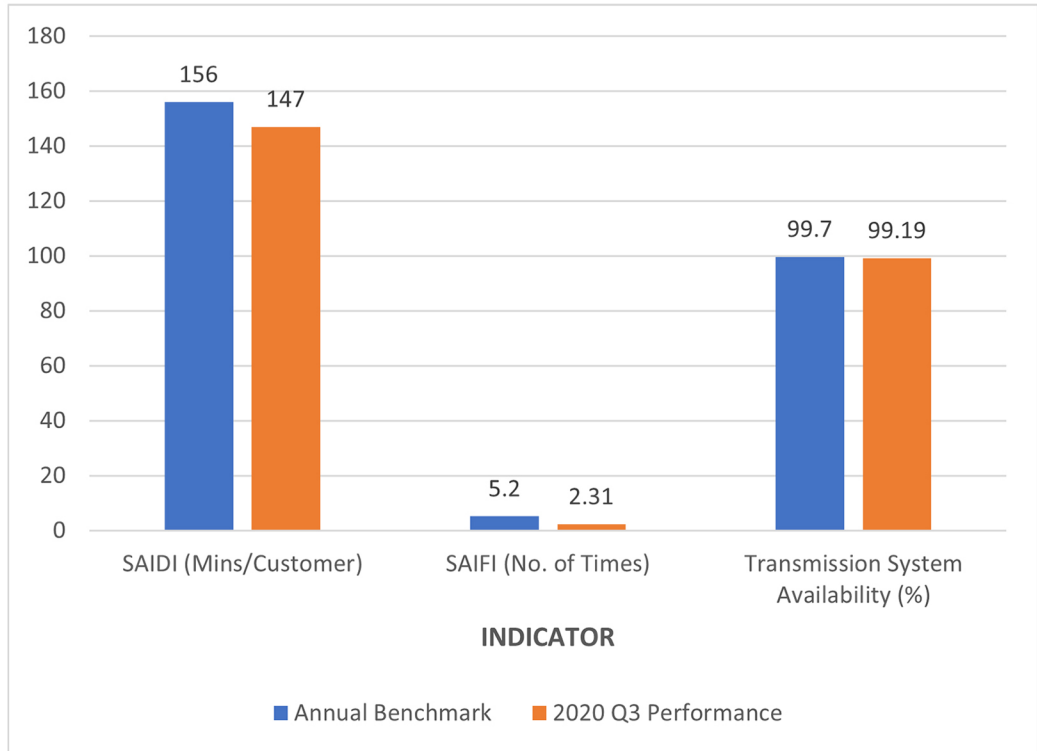

FREQUENCY DEVIATION

