



# PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

## Public Utilities Regulatory Information Systems (PURIS)

### 4th Quarter, 2021



- Total Energy Transmitted(GWh): 5551.49
- Max System Demand (MW): 3246.00
- Average Demand (MW): 2514.26
- Load Factor (%): 77.46%

#### Number of Lines Outages

- Planned (#): 63
- Unplanned (#): 405

#### Automatic Load Shedding

- Number of Incidences (#): 1
- Total Duration (hh:mm): 0:13


#### Manual Load Shedding

- Number of Incidences (#): 64
- Total Duration (hh:mm): 37:21

**SAIDI:** System Average Interruption Duration Index

**SAIFI:** System Average Interruption Frequency Index

### Performance Statistics

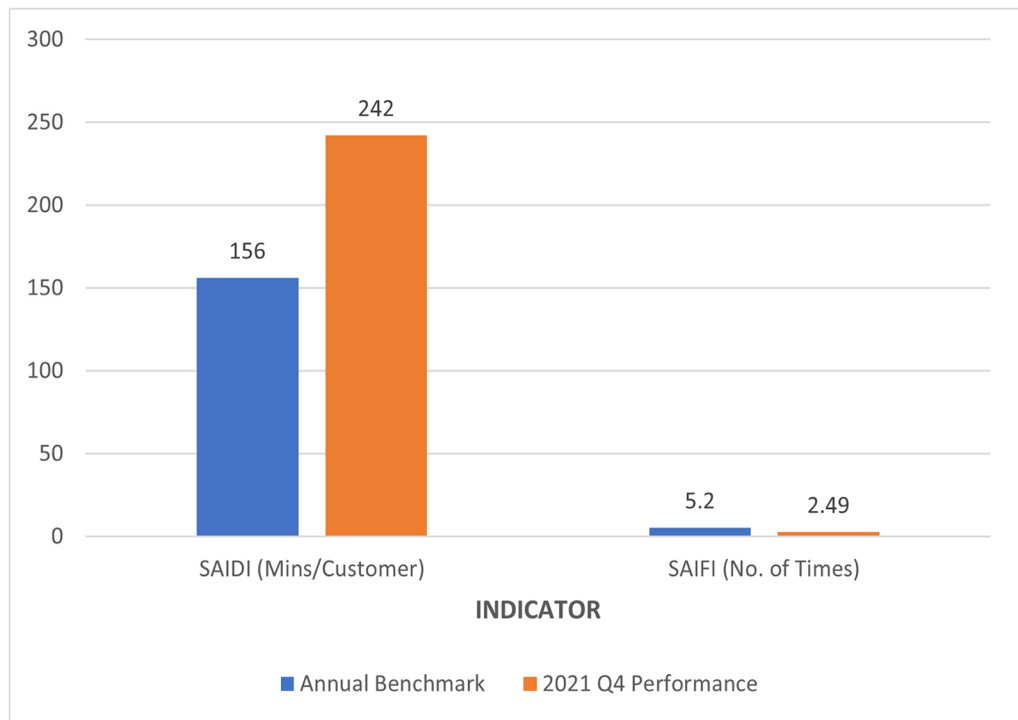

### FREQUENCY DEVIATION

