



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

3rd Quarter, 2020



- Total Energy Transmitted(GWh): **4,587.40**
- Max System Demand (MW): **2,667.00**
- Average Demand (MW): **2,077.62**
- Load Factor (%) **77.90%**

Number of Lines Outages

- Planned (#): 65
- Unplanned (#): 473


Manual Load Shedding

- Number of Incidences (#): 62
- Total Duration (hh:mm): 29:33

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

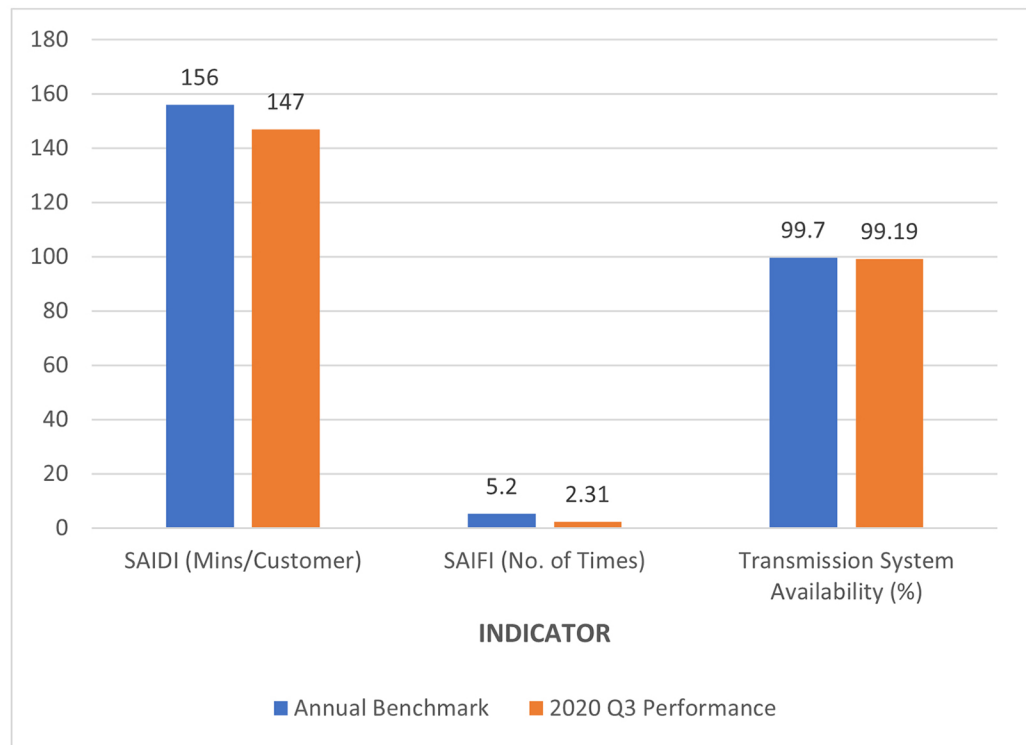

FREQUENCY DEVIATION

