



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

4th Quarter 2024



Backbone to Power Delivery

- Total Energy Transmitted(GWh): 6084.32
- Max System Demand (MW): 3952.00
- Average Demand (MW): 2755.58
- Load Factor (%): 69.73%

Number of Lines Outages

- Planned (#): 88
- Unplanned (#): 131

Automatic Load Shedding (AFLS)

- Number of incidence (#): 84
- Total Duration (hh:mm:ss): 164:01:00


Manual Load Shedding

- Number of Incidences (#): 363
- Total Duration (hh:mm:ss): 1030:36:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

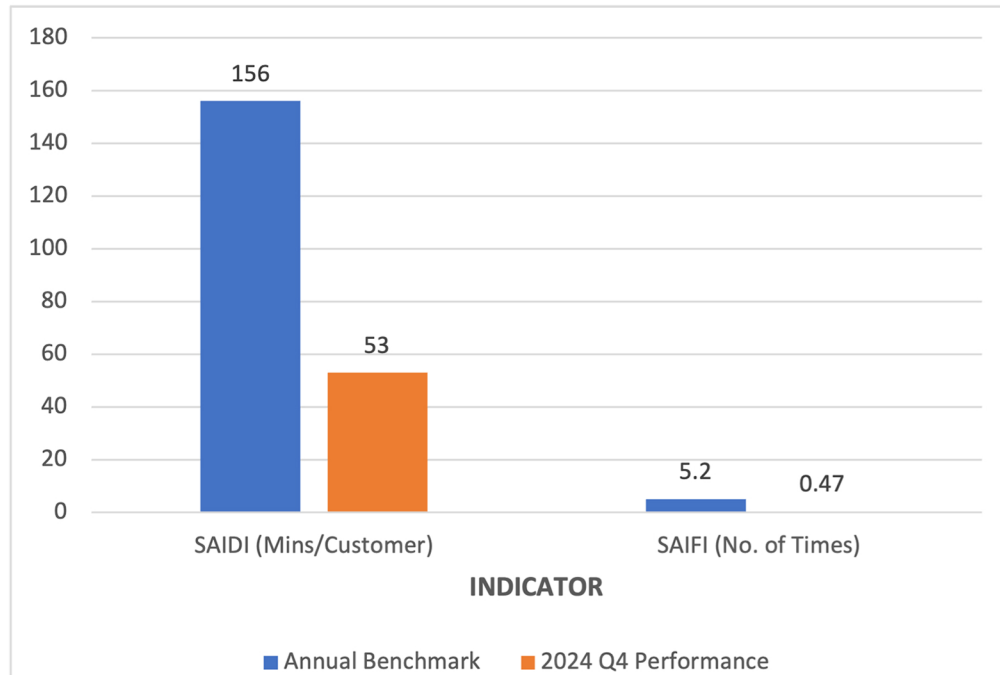

FREQUENCY DEVIATION

