



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

1st Quarter, 2020



- Total Energy Transmitted(GWh): 4,987.28
- Max System Demand (MW): 2,957.00
- Average Demand (MW): 2,283.55
- Load Factor (%): 77.23%

Number of Lines Outages

- Planned (#): 62
- Unplanned (#): 312

Automatic Load Shedding

- Number of Incidences (#): 4
- Total Duration (hh:mm): 7:45


Manual Load Shedding

- Number of Incidences (#): 132
- Total Duration (hh:mm): 203:40

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

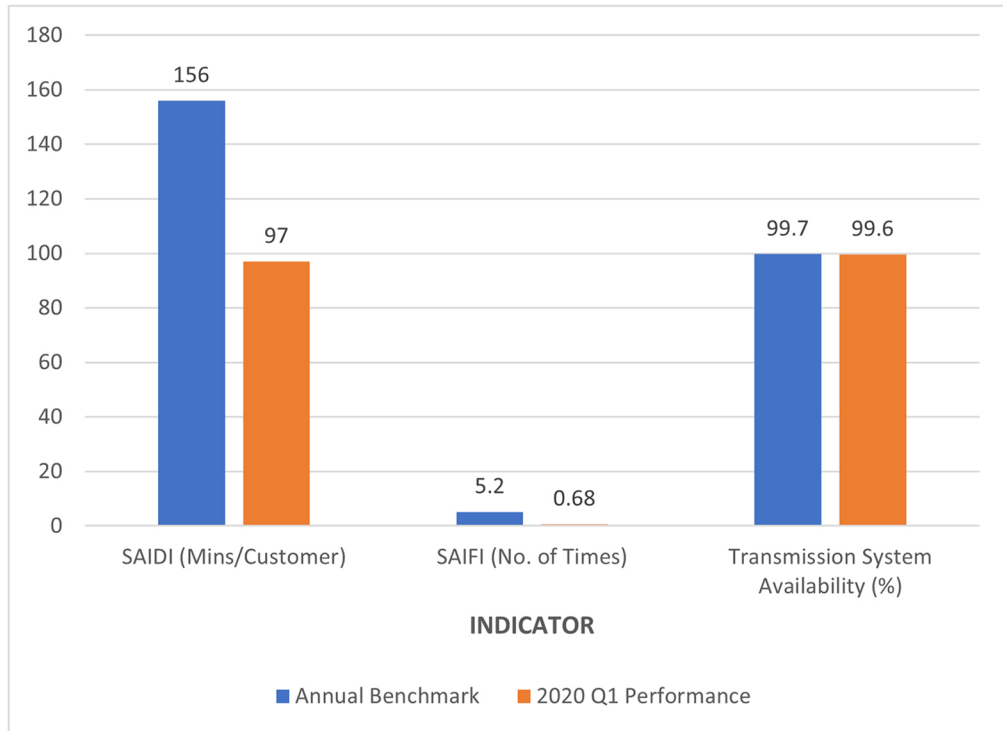

FREQUENCY DEVIATION

