



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

4th Quarter, 2023



- Total Energy Transmitted(GWh): 6106.07
- Max System Demand (MW): 3618.00
- Average Demand (MW): 2765.43
- Load Factor (%): 76.44%

Number of Lines Outages

- Planned (#): 115
- Unplanned (#): 327

Automatic Load Shedding (AFLS)

- Number of Incidences (#): 2
- Total Duration (hh:mm:ss): 7:38:00


Manual Load Shedding

- Number of Incidences (#): 124
- Total Duration (hh:mm:ss): 325:13:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

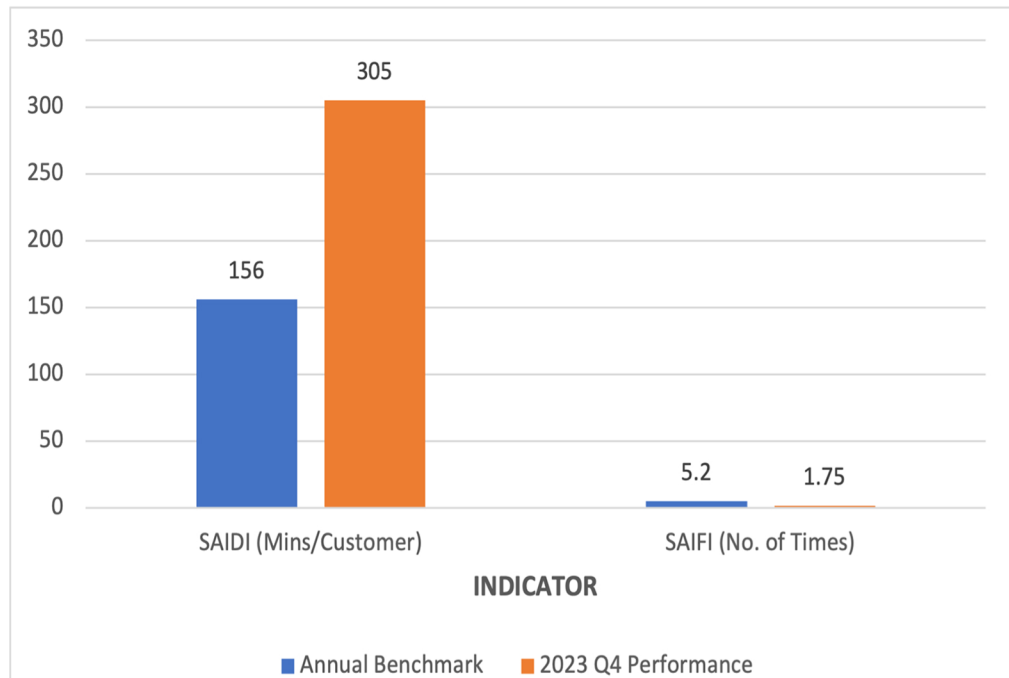

FREQUENCY DEVIATION

