



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

2nd Quarter, 2023



- **Total Energy Transmitted(GWh):**
5954.74
- **Max System Demand (MW):**
3246.00
- **Average Demand (MW):**
2696.89
- **Load Factor (%)**
83.08%

Number of Lines Outages

- **Planned (#):**
88
- **Unplanned (#):**
296

Automatic Load Shedding (AFLS)

- **Number of Incidences (#):**
3
- **Total Duration (hh:mm:ss):**
02:43


Manual Load Shedding

- **Number of Incidences (#):**
70
- **Total Duration (hh:mm:ss):**
112:22:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

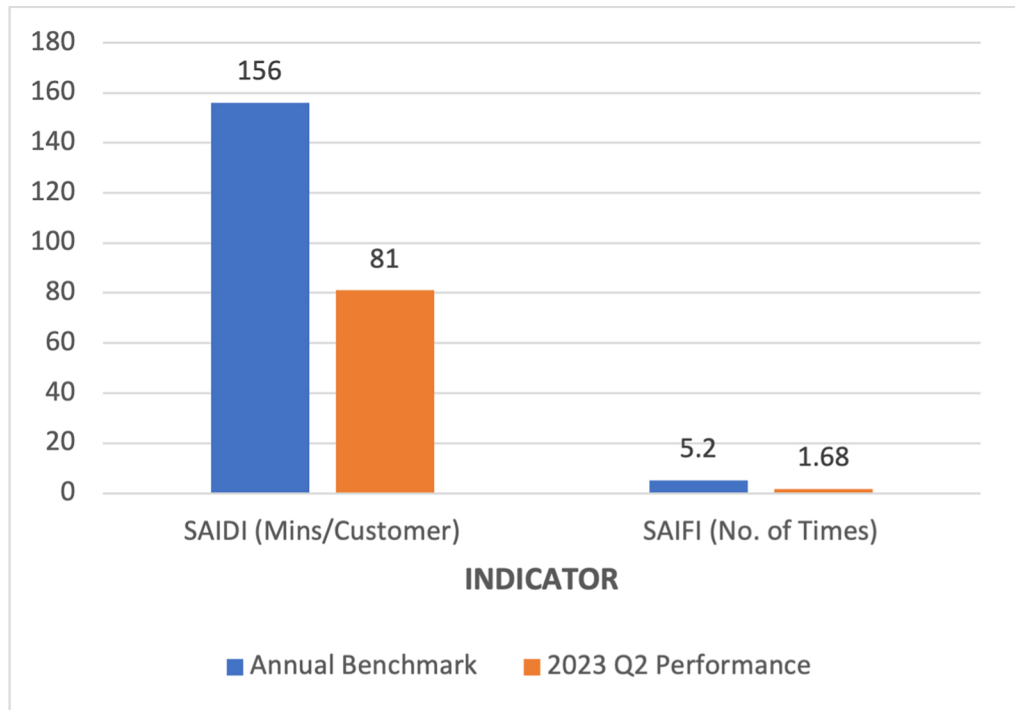

FREQUENCY DEVIATION

