



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

4th Quarter 2025



- **Total Energy Transmitted(GWh):**
7031.49
- **Max System Demand (MW):**
4283.00
- **Average Demand (MW):**
3184.55
- **Load Factor (%)**
74.35%

Number of Lines Outages

- Planned (#):
34
- Unplanned (#):
180

Automatic Load Shedding (AFLS)

- Number of incidence (#):
5
- Total Duration (hh:mm:ss):
6:56:00


Manual Load Shedding

- Number of Incidences (#):
17
- Total Duration (hh:mm:ss):
30:44:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

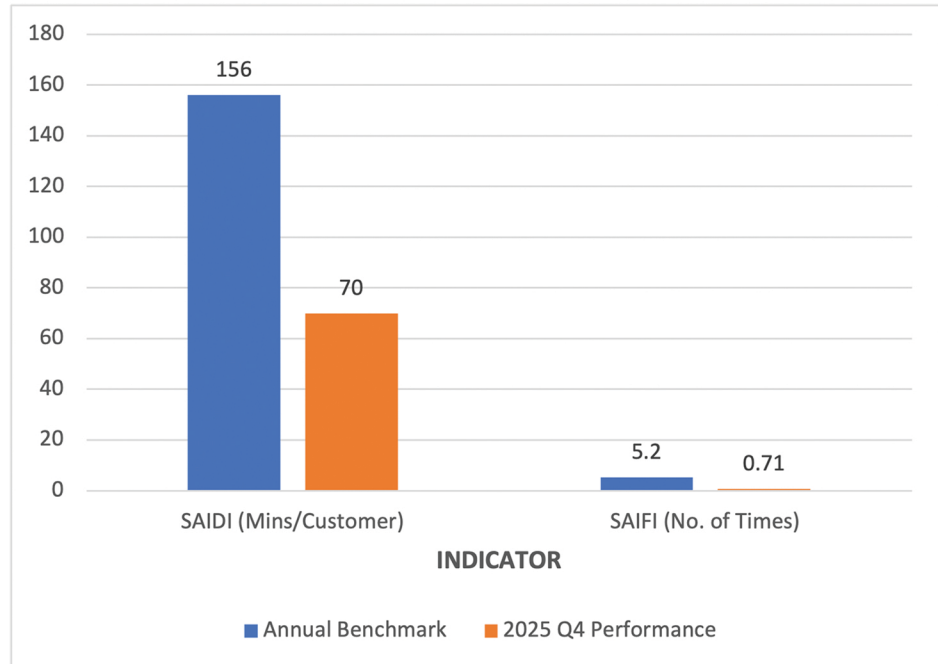

FREQUENCY DEVIATION

