



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

2nd Quarter, 2021



- **Total Energy Transmitted(GWh):**
5,442.56
- **Max System Demand (MW):**
3,206.00
- **Average Demand (MW):**
2,464.93
- **Load Factor (%)**
76.88%

Number of Lines Outages

- Planned (#):
87
- Unplanned (#):
704

Automatic Load Shedding

- Number of Incidences (#):
5
- Total Duration (hh:mm):
13:44


Manual Load Shedding

- Number of Incidences (#):
136
- Total Duration (hh:mm):
152:34

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

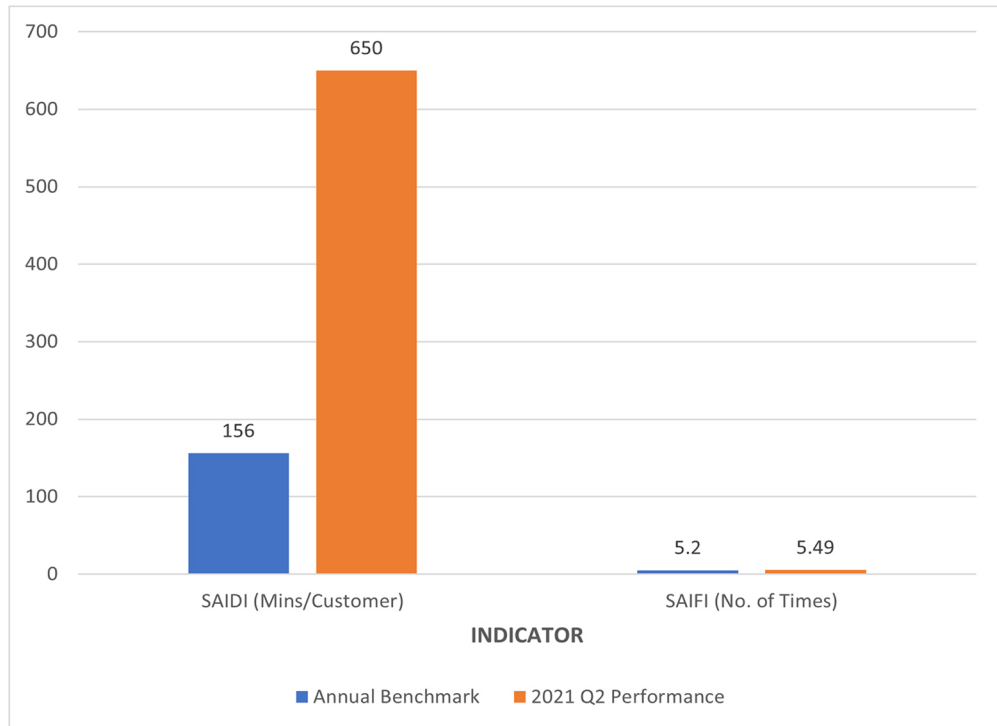

FREQUENCY DEVIATION

