



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

3rd Quarter 2024



- **Total Energy Transmitted(GWh):**
5865.74
- **Max System Demand (MW):**
3465.00
- **Average Demand (MW):**
2656.59
- **Load Factor (%)**
73.43%

Number of Lines Outages

- Planned (#):
144
- Unplanned (#):
146

Automatic Load Shedding (AFLS)

- Number of incidence (#):
4
- Total Duration (hh:mm:ss):
4:17:00


Manual Load Shedding

- Number of Incidences (#):
29
- Total Duration (hh:mm:ss):
46:13:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

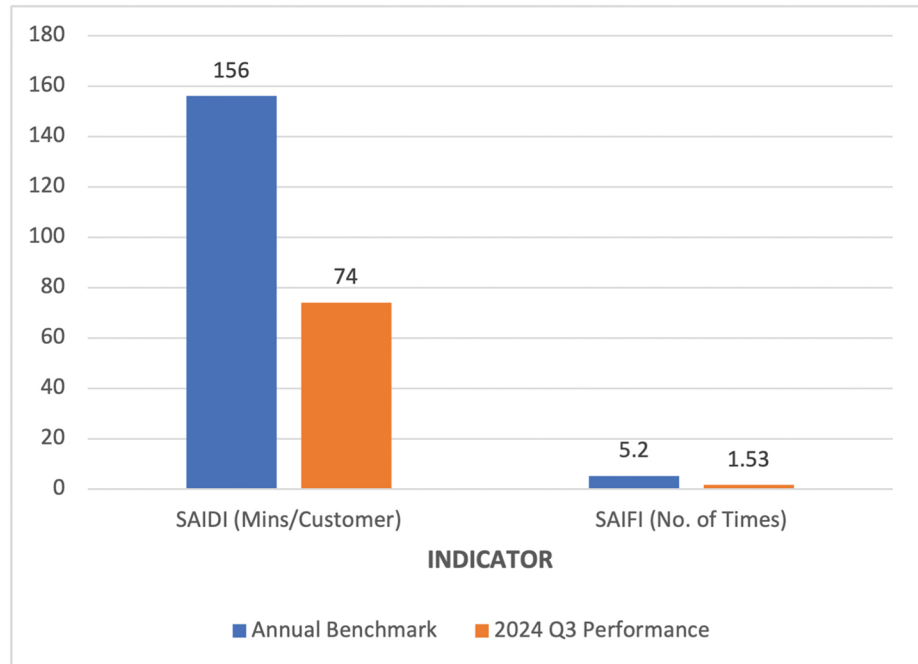

FREQUENCY DEVIATION

